
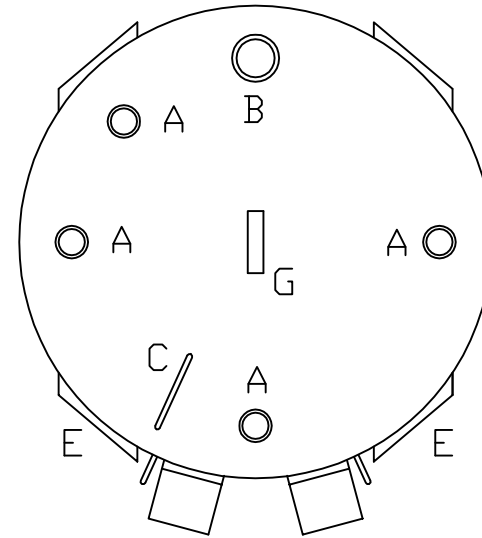


SPECIFICATIONS & CONSTRUCTION INFORMATION

MODEL: LP-1000-7 PALLET TANK  
 DESCRIPTION: ABOVEGROUND, SINGLE WALL STEEL STORAGE TANK  
 CONSTRUCTION: WELDED USING UL-142 STANDARDS  
 FINISH: SURFACE PREP: SPCC SP-3  
 ONE SPRAY COAT OF RED PRIMER  
 FINISH ENAMEL COAT IS OPTIONAL

TANK: 10 GAUGE  
 OPENINGS: MINIMUM 4-2" FNPT FLANGE  
 1-6" FNPT FLANGE  
 1-1 1/2" FNPT FLANGE W/STEEL PLUG

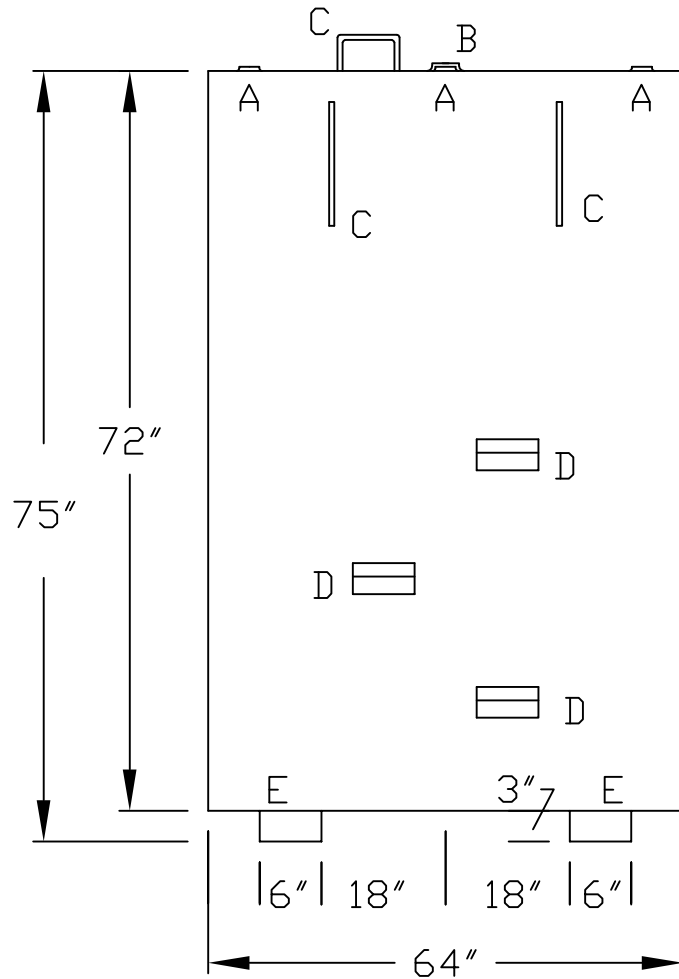

- LEGEND
- A - 2" FNPT FLANGE FOR FILL, VENT, GAUGE, ECT.
  - B - 6" FNPT FLANGE FOR EMERGENCY VENT
  - C - HAND HOLD
  - D - ANTI-SLIP STEPS
  - E - 3" X 6" X 3/16" FORK LIFT TUBE BASE

GOLDSBORO, NC  
 1-919-734-8328

TURNER TANKS LP-1000-10

DWG #: LP-1000-7

SCALE: NONE

DATE: 07/29/09

REVISION:

APPROVED:

APPROVAL DATE: